


OAC AUTOMATIC MODE OPERATION:

1. WHEN SENSORS ACTIVATE LOAD TURNS ON.
2. LOAD TURNS OFF WHEN SENSOR TIMES OUT.

RECOMMENDED WIRE:
18-3 AWG STRANDED WIRE SHIELDED OR NONSHIELDED

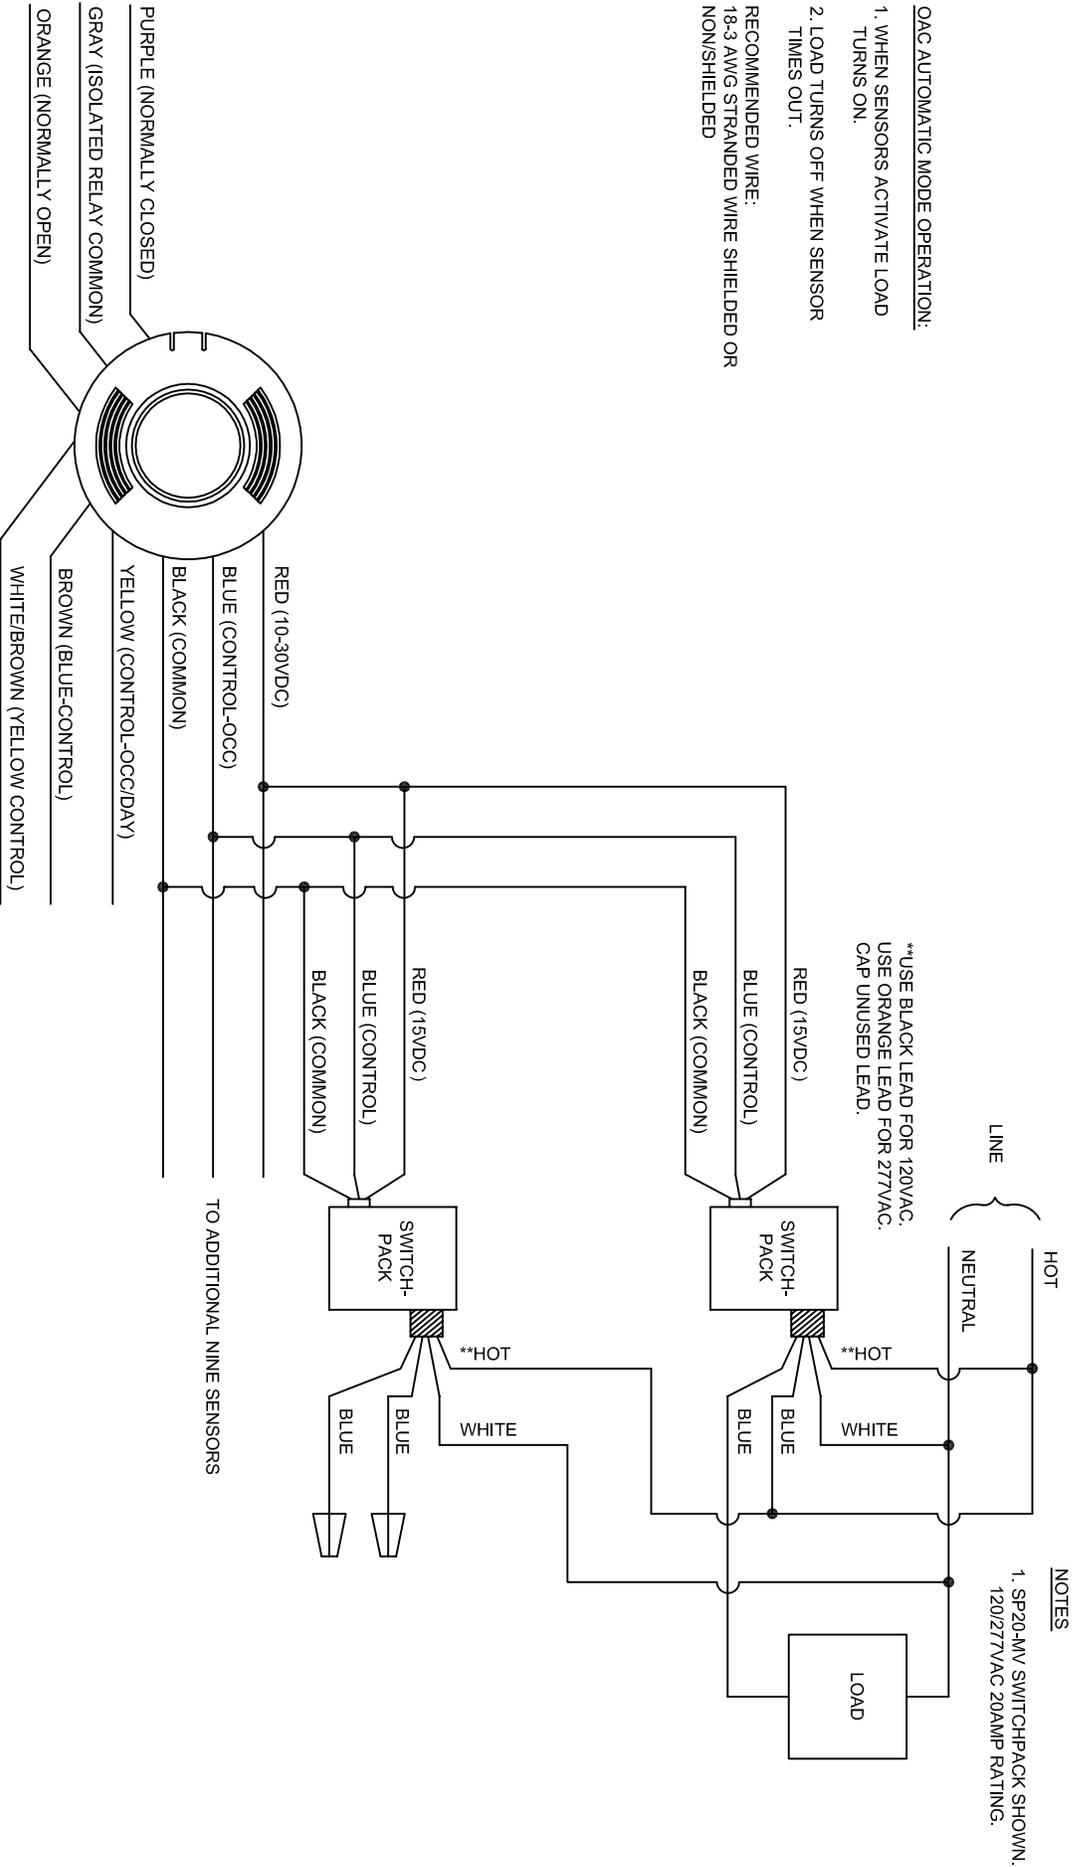

- NOTES**
1. SP20-MV SWITCHPACK SHOWN, 120/277VAC 20AMP RATING.

**USE BLACK LEAD FOR 120VAC,
USE ORANGE LEAD FOR 277VAC.
CAP UNUSED LEAD.

TO ADDITIONAL NINE SENSORS

- NOTES:**
1. SENSOR TYPE INCLUDE OAC-P-0500-R, OAC-P-1500-R, OAC-U-0501-R, OAC-U-1000-R, OAC-U-2000-R, OAC-DT-0501-R, OAC-DT-1000-R, OAC-DT-2000-R
 2. SP20-MV SWITCHPACK SHOWN. REFER TO CUT SHEETS AND/OR INSTALLATION INSTRUCTIONS FOR OTHER GREENGATE SWITCHPACK WIRING.



COOPER Controls

PROJECT	CEILING SENSOR WIRING DIAGRAM		
TITLE	MULTIPLE SENSORS AUTO ON/OFF CONTROL		
DATE	DRAWN BY	CHECKED BY	APPROVED BY
05-29-2013			
DWG NO.	REV.		
C2-1052-1-0000-000	A		

Tel: 1-800-553-3879
 Fax: 1-800-954-7016
 Addr: 203 Cooper Circle
 Peachtree City, GA 30269, USA
 ControlsSales@cooperindustries.com
 www.coopercontrol.com